SOUTHERN NEVADA BUILDING OFFICIALS REGIONAL STANDARDS

P-101 6-24-08 PG. 1 OF 1

LIQUIFIED PETROLEUM GAS PIPING-PROCEDURES

Clark County

Dept. of Develop. Services 4701 W Russell Rd Las Vegas, NV 89118 (702) 455-3000

Boulder City


Building Department 401 California Avenue Boulder City, NV 89005 (702) 293-9282

Henderson

Bldg & Fire Safety Dept. 240 Water Street Henderson, NV 89015 (702) 267-3650

Las Vegas

Building & Safety Dept. 731 S. 4th Street Las Vegas, NV 89101 (702) 229-6916

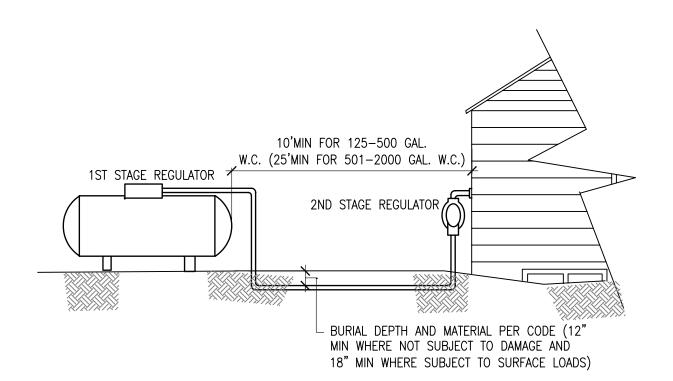

PERMIT APPLICATION WITH PLANS SHALL GIVE SCOPE OF WORK IN COMPLIANCE WITH APPLICABLE CODES.

PLANS SHALL SHOW LENGTHE OF PIPE, FIXTURE DEMANDS IN BTU AND PIPE SIZES.

INSPECTIONS SHALL BE REQUESTED FOR UNDERGROUND ROUGH AND FINAL INSTALLATIONS IN ACCORDANCE WITH THE SCOPE OF WORK DEFINED BY PERMIT AND APPROVED PLANS.

NOTE: L.P. TANK IS NOT REQUIRED TO BE SET BEFORE INSPECTION OF PIPING IS GIVEN AND GAS TAG ISSUED.

NOTE: TANK PLACEMENT AND LOCATION SHALL BE APPROVED BY THE CODE OFFICIAL.

INSPECTIONS SHALL OBSERVE PRESSURE TEST ON PIPING FROM OUTLET SIDE OF 1ST STAGE REGULATOR AND OUTLET SIDE OF 2ND STAGE REGULATOR. FIRST STAGE OUTLET PRESSURE, MINIMUM 60 PSI. SECOND STAGE OUTLET PRESSURE, MINIMUM 10 PSI.

NOTE: IN SOME INSTALLATIONS A HIGH/LOW (PIGGYBACK) REGULATOR MAY BE INSTALLED AT THE TANK IN LIEU OF SEPARATE REGULATORS AT THE TANK AND THE RESIDENCE. IN THIS CASE THE PRESSURE TEST WILL BE A MINIMUM OF 10 PSI AT THE TANK REGULATOR LOCATION.

PRESSURE TEST VERIFICATION SHALL BE MADE AT THE FINAL INSPECTION.

MUST CONFORM TO NFPA 58-2004, 54-2006 AND 2006 UMC.

Mesquite

Building Department 10 East Mesquite Blvd. Mesquite, NV 89027 (702) 346-2835

North Las Vegas

Building Department 2240 Civic Center Drive N. Las Vegas, NV 89030 (702) 633-1577

Pahrump

Regional Planning District 1210 E. Basin Avenue, Suite #1 Pahrump, NV 89060 (775) 751-3373